

G1902P Safety Station with Eyewash, Plastic Bowl

Application: Combination eyewash and shower safety station. Two GS-Plus[™] spray-type outlet heads deliver a flood of water for rinsing eyes.

Shower Head: 10" diameter orange ABS plastic.

Shower Valve: 1" IPS chrome plated brass stay-open ball valve. Valve is US-made with chrome plated brass ball and Teflon® seals. Furnished with stainless steel actuating arm and 29" stainless steel pull rod.

Spray Head Assembly: Two GS-Plus[™] spray heads. Each head has a "flip top" dust cover, internal flow control and filter to remove impurities from water.

Eyewash Bowl: 11-1/2" ABS plastic.

Eyewash Valve: 1/2" IPS chrome plated brass stay-open ball valve. Valve is US-made with chrome plated brass ball and Teflon[®] seals.

Pipe and Fittings: Schedule 40 galvanized steel. Furnished with orange polyethylene covers for vertical piping for high visibility and corrosion resistance.

Supply: 1-1/4" NPT female top or side inlet.

Waste: 1-1/4" NPT female outlet. Outlet can be positioned at either 9-1/4" or 19-5/8" above finished floor by reversing lower pipe nipples.

Sign: Furnished with ANSI-compliant identification sign.


Quality Assurance: Valve and spray head assemblies are factory assembled and water tested prior to shipment.

Available Options

- **GC** Powder coated finish on galvanized Pipe and Fittings. Available colors include orange, yellow, red and green.
- **FC20** Regulates shower flow rate to 20 GPM.
- **GRN** Green ABS plastic shower head and bowl.
- YEL Yellow ABS plastic shower head and bowl.
- **SSH** Stainless steel shower head.
- AP275-100 Electric Light and Alarm Horn Light and alarm horn summon assistance when eyewash or shower is activated.
- AP250-015 Modesty Curtain

Modesty curtain for mounting on safety station.

TMV G3800LF thermostatic mixing valve precisely blends hot and cold water to deliver warm (tepid) water as required by ANSI Z358.1-2009.

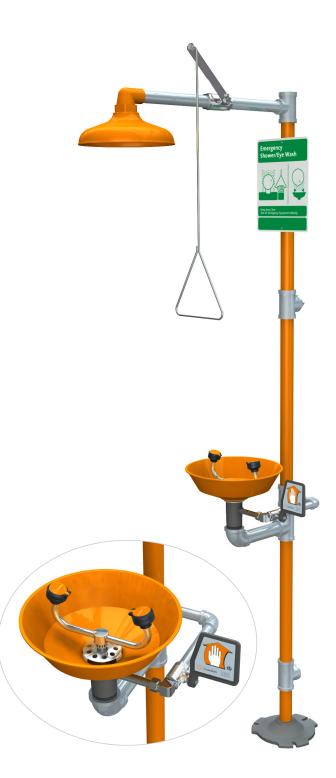

Guardian Equipment 1140 N North Branch St 312 447 8101 FACSIMILE Chicago, IL 60642

312 447 8100 теlephone gesafety.com

Listed 8116. Units have been tested to and comply with ANSI Z358.1-2009 and the Uniform Plumbing Code. C






ETL Listed 101496. Units have been tested to and comply with ANSI 7358.1-2009.



G1902P Safety Station with Eyewash, Plastic Bowl

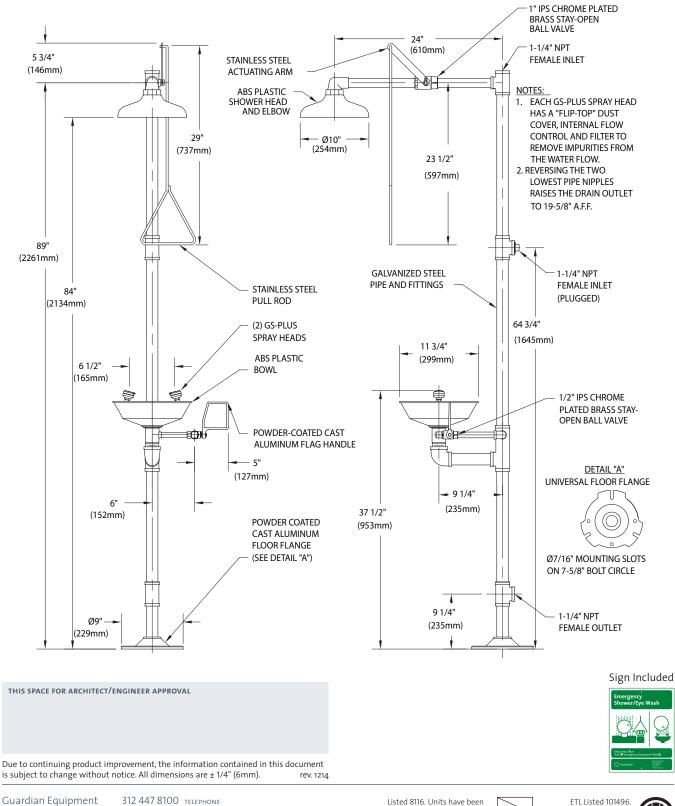

Guardian Equipment 1140 N North Branch St Chicago, IL 60642 312 447 8100 теlephone 312 447 8101 _{FACSIMILE} gesafety.com Listed 8116. Units have been tested to and comply with ANSI Z358.1-2009 and the Uniform Plumbing Code.



